

FX/FXH/FXL Series

DIN W72×H72, W48×H96, W144×H72mm Counter/Timer

■ Features

- 36 input modes and 20 output modes
- Counting speed: 1cps/30cps/2kcps/5kcps
- Selectable voltage input (PNP) or No voltage input (NPN)
- Addition of Up/Down input mode
- Wide range of power supply: 100-240VAC 50/60Hz
12-24VAC 50/60Hz, 12-24VDC universal
- Selectable Counter/Timer by internal DIP switch
- Various time range
- Built-in Microprocessor



⚠ Please read "Caution for your safety" in operation manual before using.



■ Ordering Information

| | | | | | |
|----|---|---------|---------|----|------------------|
| FX | 4 | H | — | 2P | |
| | | | | | Output |
| | | | | | Size |
| | | | | | Digit |
| | | | | | Item |
| | | | No mark | | 1-stage preset |
| | | | 2P | | 2-stage preset |
| | | | I | | Indicator |
| | | L | | | DIN W144×H72mm |
| | | H | | | DIN W48×H96mm |
| | | No mark | | | DIN W72×H72mm |
| | 4 | | | | 9999 (4-digit) |
| | 6 | | | | 999999 (6-digit) |
| FX | | | | | Counter/Timer |

■ Specifications

| Model | 1-stage preset | FX4 | FX6 | FX4H | — | — |
|----------------------------------|--------------------------|---|--|----------|----------|---------|
| | 2-stage preset | FX4-2P | FX6-2P | FX4H-2P | FX4L-2P | FX6L-2P |
| | Indicator | FX4-I | FX6-I | FX4H-I | FX4L-I | FX6L-I |
| Digit | | 4-digit | 6-digit | 4-digit | 4-digit | 6-digit |
| Digit size | | W8×H14mm | W4×H8mm | W6×H10mm | W8×H14mm | |
| Power supply | AC voltage | 100-240VAC 50/60Hz | | | | |
| | AC/DC voltage | 12-24VAC 50/60Hz, 12-24VDC | | | | |
| Allowable voltage range | | 90 to 110% of rated voltage | | | | |
| Power consumption | AC voltage | • Indicator: Max. 6VA • 1-stage preset: Max. 7VA • 2-stage preset: Max. 8VA (100-240VAC 50/60Hz) | | | | |
| | AC/DC voltage | • Indicator: Max. 5.8VA • 1-stage preset: Max. 6.8VA • 2-stage preset: Max. 7.6VA (12-24VAC 50/60Hz) • Indicator: Max. 2.7W • 1-stage preset: Max. 3.3W • 2-stage preset: Max. 3.8W (12-24VDC) | | | | |
| Max. counting speed for CP1, CP2 | | Selectable 1cps/30cps/2kcps/5kcps by internal DIP switch | | | | |
| Min. input signal width | INHIBIT input | Approx. 20ms | | | | |
| | RESET input | | | | | |
| Input | CP1, CP2 input (INHIBIT) | Input logic is selectable [Voltage input] Input impedance: Max. 5.4kΩ, [H]: 5-30VDC, [L]: 0-2VDC [No-voltage input] Impedance at short-circuit: Max. 1kΩ, Residual voltage at short-circuit: Max. 2VDC, Impedance at open-circuit: Min. 100kΩ | | | | |
| | RESET input | | | | | |
| One-shot output time | | • 1-stage preset: 0.05 to 5sec • 2-stage preset: 1st. output 0.5sec fixed, 2nd. output: 0.05 to 5sec | | | | |
| Control output | Contact | Type | • 1-stage preset: SPDT (1c), • 2-stage preset: 1st. output SPDT (1c), 2nd. output SPDT (1c) | | | |
| | | Capacity | 250VAC 3A at resistive load | | | |
| | Solid state | Type | • 1-stage preset: 1 NPN open collector • 2-stage preset: 1st. output 1 NPN open collector, 2nd. output 1 NPN open collector | | | |
| | | Capacity | Max. 30VDC, 100mA | | | |
| Memory protection | | Approx. 10 years (when using non-volatile semiconductor memory) | | | | |
| External sensor power | | Max. 12VDC±10% 50mA | | | | |
| Environment | Ambient temperature | -10 to 55°C, storage: -25 to 65°C | | | | |
| | Ambient humidity | 35 to 85%RH, storage: 35 to 85%RH | | | | |
| Insulation resistance | | Over 100MΩ (at 500VDC megger) | | | | |
| Dielectric strength | | 2,000VAC 50/60Hz for 1 minute | | | | |
| Noise immunity | AC voltage | ±2kV the square wave noise (pulse width: 1μs) by the noise simulator | | | | |
| | DC voltage | ±500V the square wave noise (pulse width: 1μs) by the noise simulator | | | | |

※Environment resistance is rated at no freezing or condensation.

Thumbwheel Switch Setting Type Up/Down Counter/Timer


Specifications

| | | | | | | | | | | |
|----------------------|------------------------------------|--|---------|-----------------------------|----------|-----------------------------|----------|-----------------------------|----------|-----------------------------|
| Vibration | Mechanical | 0.75mm amplitude at frequency of 10 to 55Hz (for 1 min) in each X, Y, Z direction for 1 hour | | | | | | | | |
| | Malfunction | 0.5mm amplitude at frequency of 10 to 55Hz (for 1 min) in each X, Y, Z direction for 10 min | | | | | | | | |
| Shock | Mechanical | 300m/s ² (approx. 30G) in each X, Y, Z direction for 3 times | | | | | | | | |
| | Malfunction | 100m/s ² (approx. 10G) in each X, Y, Z direction for 3 times | | | | | | | | |
| Relay life cycle | Mechanical | Min. 10,000,000 operations | | | | | | | | |
| | Electrical | Min. 100,000 operations (at 250VAC 3A resistive load) | | | | | | | | |
| Approval | UL (except for AC/DC voltage type) | | | | | | | | | |
| Weight ^{*1} | FX4: | Approx. 385g (approx. 249g) | FX6: | Approx. 395g (approx. 259g) | FX4H: | Approx. 349g (approx. 234g) | FX4L-2P: | Approx. 651g (approx. 467g) | FX6L-2P: | Approx. 678g (approx. 494g) |
| | FX4-2P: | Approx. 396g (approx. 258g) | FX6-2P: | Approx. 398g (approx. 262g) | FX4H-2P: | Approx. 375g (approx. 261g) | FX4L-I: | Approx. 593g (approx. 400g) | FX6L-I: | Approx. 586g (approx. 404g) |
| | FX4-I: | Approx. 353g (approx. 216g) | FX6-I: | Approx. 351g (approx. 214g) | FX4H-I: | Approx. 321g (approx. 206g) | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |


*1: The weight includes packaging. The weight in parenthesis is for unit only.

Connections


FX□-2P

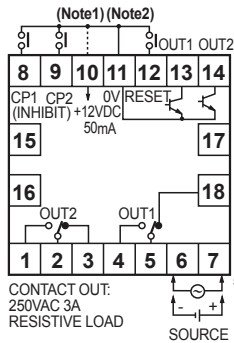


FX□

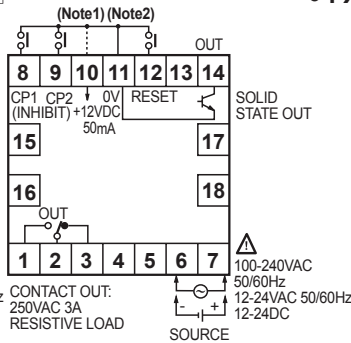


FX□-I

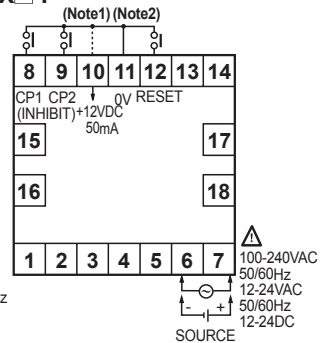


FX4H-2P

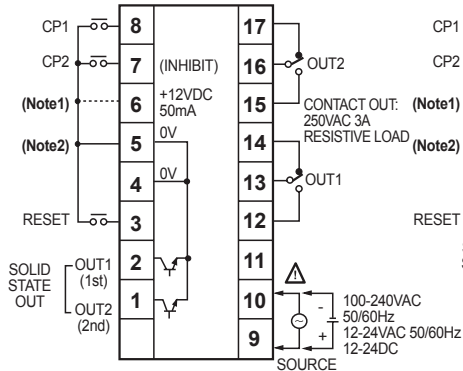


FX4H

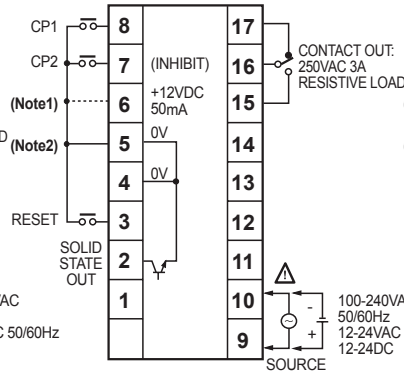


FX4H-I

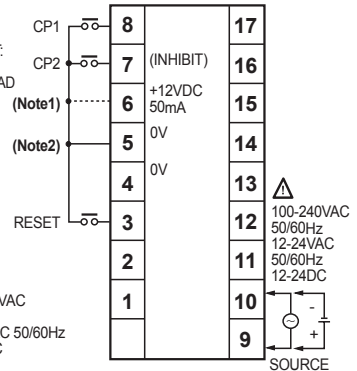

FX□L-2P

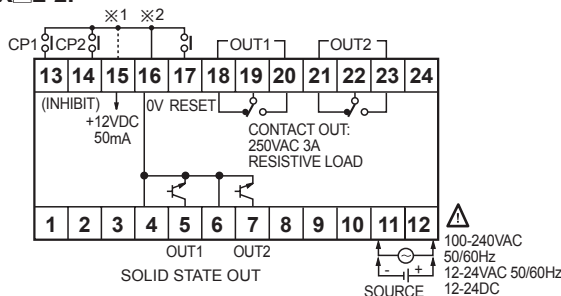

FX□L-I

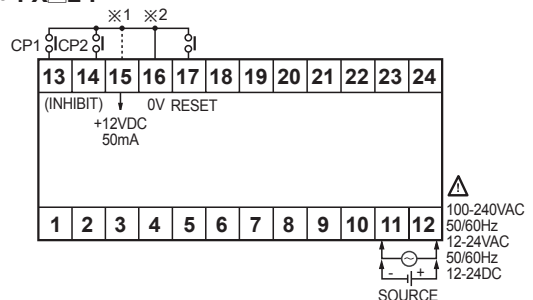

※ CP2 (INHIBIT): Time hold terminal when using for timer.
 ※ It is operated by power ON start type when using for timer.

※1: Connection for PNP input
 ※2: Connection for NPN input



| |
|---|
| (A) Photoelectric Sensors |
| (B) Fiber Optic Sensors |
| (C) Door/Area Sensors |
| (D) Proximity Sensors |
| (E) Pressure Sensors |
| (F) Rotary Encoders |
| (G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets |
| (H) Temperature Controllers |
| (I) SSRs / Power Controllers |
| (J) Counters |
| (K) Timers |
| (L) Panel Meters |
| (M) Tacho / Speed / Pulse Meters |
| (N) Display Units |
| (O) Sensor Controllers |
| (P) Switching Mode Power Supplies |
| (Q) Stepper Motors & Drivers & Controllers |
| (R) Graphic/ Logic Panels |
| (S) Field Network Devices |
| (T) Software |

FX/FXH/FXL Series


Dimensions

FX Series

(unit: mm)





Panel cut-out




FXH Series

(unit: mm)

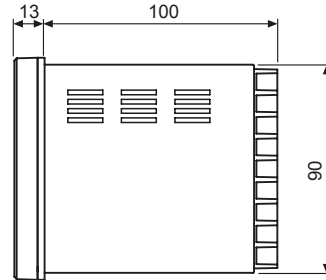



Panel cut-out




FXL Series

(unit: mm)

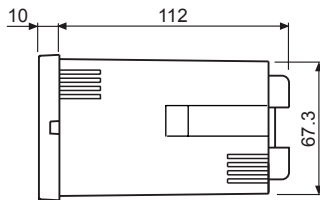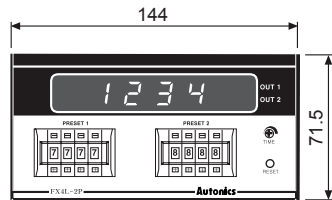


Panel cut-out

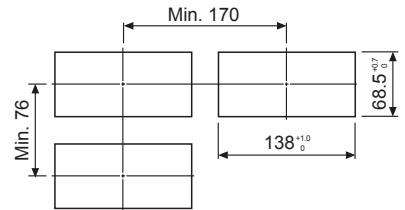


Input Connections

No-voltage input (NPN) (factory default)

Solid-state input (standard sensor: NPN output type sensor)

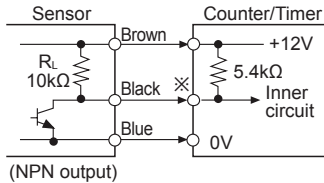


※CP1, CP2 (INHIBIT), RESET input

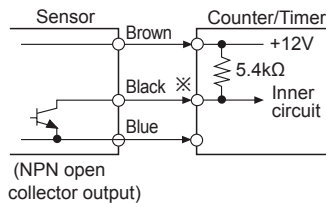

(NPN open collector output)


Contact input




※Counting speed:
1 or 30cps setting (counter)

Voltage input (PNP)

Solid-state input (standard sensor: PNP output type sensor)

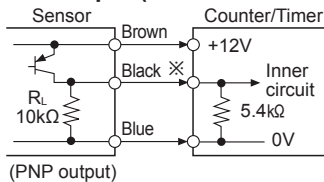


※CP1, CP2 (INHIBIT), RESET input

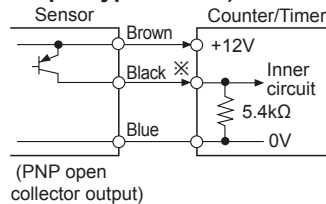

(PNP open collector output)

Contact input



※Counting speed:
1 or 30cps setting (counter)


Thumbwheel Switch Setting Type Up/Down Counter/Timer

Input Logic Selection

FX Series

Input logic is changeable by input logic selection switch located at the one-side of case.

- No-voltage input (NPN)
- Voltage input (PNP)

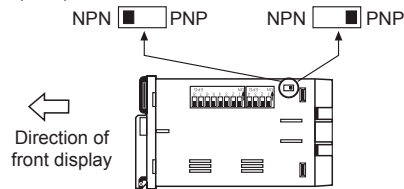

※Please be sure to turn power OFF before changing input logic.


FXL Series

Input logic is changeable by input logic selection switch located at the terminal block.

- No-voltage input (NPN) (NPN) F S
- Voltage input (PNP) F S (PNP)


FXH Series

Input logic is changeable by input logic selection switch (SW3) located at inside of the case.

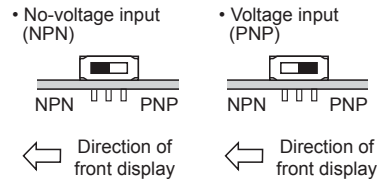

Input & Output Connections

In case of operating the load by power supply of the sensor

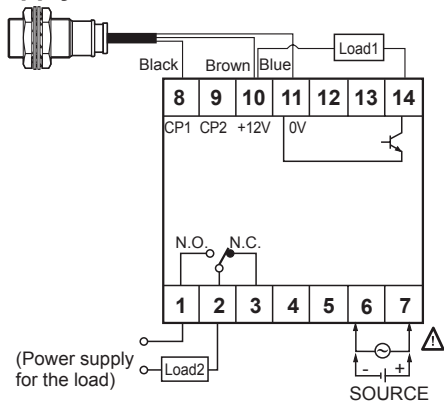


- Please select proper capacity of load, because total value of load capacity and current consumption should not exceed current capacity. (Max. 50mA)


How to count by external power supply

This unit starts to count when "High" level (5-30VDC) is applied at CP1 or CP2 after selecting PNP. ("Low" level: 0-2VDC)

In case of operating the load by external power supply

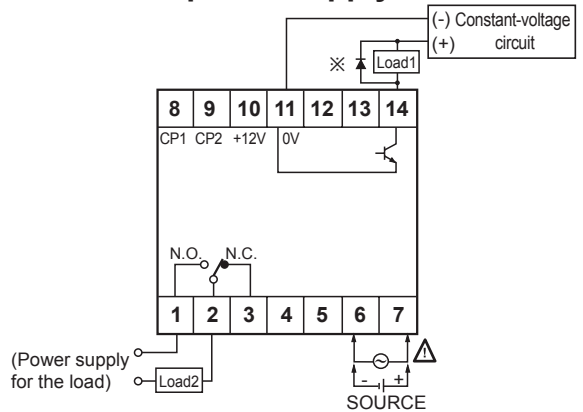


- The capacity of the load must not exceed max. 30VDC, max. 100mA of the switching capacity of the transistor.
- Please do not supply the reverse polarity voltage.
- ※Please connector the surge absorber (Diode) at both terminals of the load, in case of using the inductive load. (Relay, etc.)

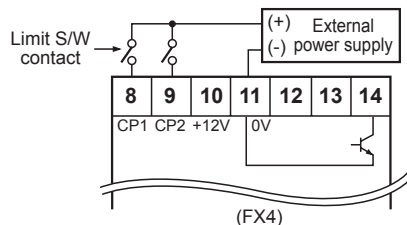

Using 2 counters with one sensor

Please connect as the power of sensor is supplied from only one of counters and design input logic with same way.

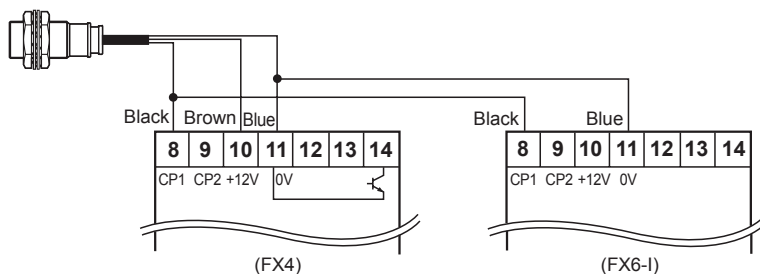


| | |
|-----|---|
| (A) | Photoelectric Sensors |
| (B) | Fiber Optic Sensors |
| (C) | Door/Area Sensors |
| (D) | Proximity Sensors |
| (E) | Pressure Sensors |
| (F) | Rotary Encoders |
| (G) | Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets |
| (H) | Temperature Controllers |
| (I) | SSRs / Power Controllers |
| (J) | Counters |
| (K) | Timers |
| (L) | Panel Meters |
| (M) | Tacho / Speed / Pulse Meters |
| (N) | Display Units |
| (O) | Sensor Controllers |
| (P) | Switching Mode Power Supplies |
| (Q) | Stepper Motors & Drivers & Controllers |
| (R) | Graphic/ Logic Panels |
| (S) | Field Network Devices |
| (T) | Software |


FX/FXH/FXL Series

■ Description Of Inner DIP Switches



● FX Series

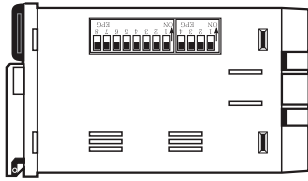

● FXH Series

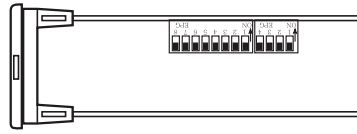


● FXL Series

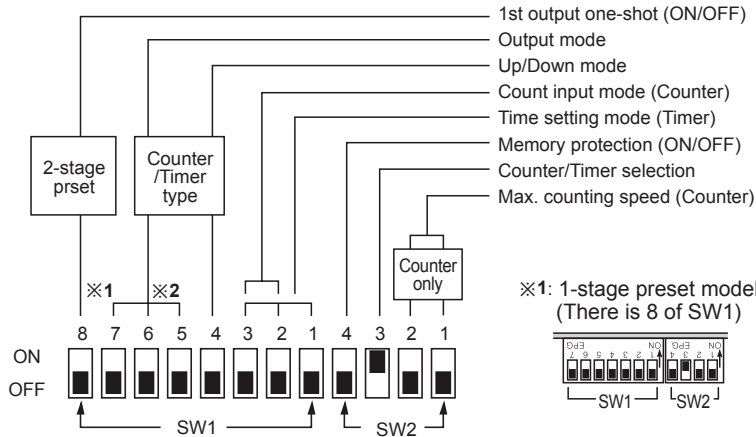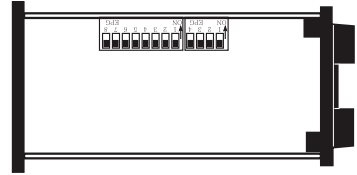

※1: 1-stage preset model
(There is 8 of SW1)

※2: Indication model
(There is 5, 6, 7, 8 of SW1)



● Max. counting speed

| SW2 | Functions |
|------------------------|-----------|
| SW2 1: ON, SW2 2: OFF | 1cps |
| SW2 1: ON, SW2 2: ON | 30cps |
| SW2 1: OFF, SW2 2: OFF | 2kcps |
| SW2 1: OFF, SW2 2: ON | 5kcps |

● Counter/Timer selection

| SW2 | Functions |
|------------|-----------|
| SW2 3: ON | Counter |
| SW2 3: OFF | Timer |

● Memory protection

| SW2 | Functions |
|------------|-------------------------------|
| SW2 4: ON | Disable the memory protection |
| SW2 4: OFF | Enable the memory protection |

● Up/Down mode selection


| SW1 | Functions |
|------------|-----------|
| SW1 4: ON | Down mode |
| SW1 4: OFF | Up mode |

● 1st output one-shot (ON/OFF)

| SW1 | Functions |
|------------|-----------------------------|
| SW1 8: ON | 1st output: One-shot output |
| SW1 8: OFF | 1st output: Retained output |

※ This mode selects a one-shot output (0.5sec fixed) or retained output (until 2nd output turns off) for 1st output in the 2-stage preset coounter.

※ Example of F output operation mode

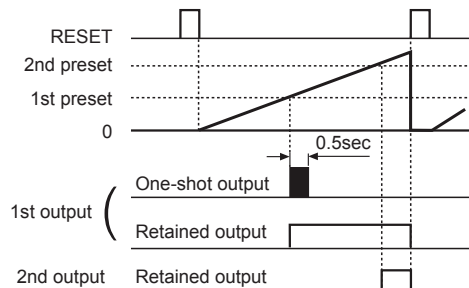

Thumbwheel Switch Setting Type Up/Down Counter/Timer

Input Operation (Counter)

| Input mode | | SW1 | No-voltage input type (NPN) | Voltage input type (PNP) |
|------------|---|--|-----------------------------|--------------------------|
| Up mode | ON <input type="checkbox"/> 4 OFF <input checked="" type="checkbox"/> Up/Down-A (Command input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Up/Down-B (Individual input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Up/Down-C (Phase difference input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Up (Count up input) | ON <input checked="" type="checkbox"/> 2 3 OFF <input type="checkbox"/> <input type="checkbox"/> | | |
| | | | | |
| Down mode | ON <input checked="" type="checkbox"/> 4 OFF <input type="checkbox"/> Up/Down-D (Command input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Up/Down-E (Individual input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Up/Down-F (Phase difference input) | ON <input type="checkbox"/> 2 3 OFF <input checked="" type="checkbox"/> <input checked="" type="checkbox"/> | | |
| | Down (Count down input) | ON <input checked="" type="checkbox"/> 2 3 OFF <input type="checkbox"/> <input type="checkbox"/> | | |
| | | | | |

※Ⓐ: Over min. signal width, Ⓑ: Over 1/2 of min. signal width.
If the signal width of Ⓐ or Ⓑ is less than min. signal width, ±1 of count error occurs.

- (A) Photoelectric Sensors
- (B) Fiber Optic Sensors
- (C) Door/Area Sensors
- (D) Proximity Sensors
- (E) Pressure Sensors
- (F) Rotary Encoders
- (G) Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets
- (H) Temperature Controllers
- (I) SSRs / Power Controllers
- (J) Counters
- (K) Timers
- (L) Panel Meters
- (M) Tacho / Speed / Pulse Meters
- (N) Display Units
- (O) Sensor Controllers
- (P) Switching Mode Power Supplies
- (Q) Stepper Motors & Drivers & Controllers
- (R) Graphic/ Logic Panels
- (S) Field Network Devices
- (T) Software


FX/FXH/FXL Series

Time Setting Mode (Timer)


| SW1 | | 4-digit | 6-digit |
|-----|-----|---------|--------------|
| A | ON | 1 2 3 | 99999.9sec |
| | OFF | ■ ■ ■ | |
| B | ON | 1 2 3 | 999.9sec |
| | OFF | ■ ■ ■ | |
| C | ON | 1 2 3 | 9999sec |
| | OFF | ■ ■ ■ | |
| D | ON | 1 2 3 | 99min 59sec |
| | OFF | ■ ■ ■ | |
| E | ON | 1 2 3 | 999.9min |
| | OFF | ■ ■ ■ | |
| F | ON | 1 2 3 | 99hour 59min |
| | OFF | ■ ■ ■ | |
| G | ON | 1 2 3 | 999.9hour |
| | OFF | ■ ■ ■ | |
| H | ON | 1 2 3 | 9999hour |
| | OFF | ■ ■ ■ | |

Counting Operation Of Indication Type (Counter)


Up mode




Up / Down-A, B, C mode



Down mode




Up / Down-D, E, F mode




Time Operation Of Indication Type (Timer)


Up mode



Down mode




Setting Function Of Decimal Point

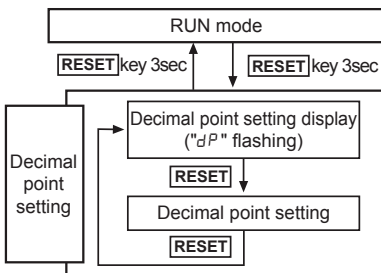


- ※ It advances to "Decimal point setting mode" if press RESET key for 3sec
- ※ It returns to RUN mode by press RESET key for 3sec in "Decimal point setting mode".
- ※ It returns to RUN mode if no RESET button or digital switch (Dual-setting digital switch for dual preset type) is applied for 60sec in the "Decimal point setting mode".
- ※ The decimal point setting does not exist in indicator.

Decimal point setting

- The decimal point setting of 6-digits indicator



- The decimal point setting of 4-digits indicator



- ※ Existing decimal point setting is displayed when entering into decimal point setting mode.
- ※ If pressing one of digital switch (2nd preset type: 2nd preset digital switch) Up (+) buttons in decimal point setting mode, decimal point will be moved to Up (+) direction.
- If pressing one of digital switch (2nd preset type: 2nd preset digital switch) Down (-) buttons, decimal point will be moved to Down (-) direction.

Thumbwheel Switch Setting Type Up/Down Counter/Timer

Output Operation Mode

← One-shot output (0.05 to 5sec) of 2nd output
 ← Retained output
 ← Retained output
 ✕ The output of 1-stage preset type is operated at the status of the second output mode

| Output mode (SW1) | 4 ON OFF Up mode | | 4 ON OFF Down mode | | Operation after count up |
|--------------------------|------------------------------|--|------------------------------|--|--|
| | Up, Up / Down-A, B, C | | Down, Up / Down-D, E, F | | |
| F ON OFF | | | | | The display value continues until Reset signal applied and the output is held. <ul style="list-style-type: none"> • 1st retained output and 2nd output are maintained until Reset signal is applied. • When using 1st output as one-shot output, it will return after operating for 0.5sec |
| N ON OFF | | | | | The display value and output will be held until Reset input is applied. |
| C ON OFF | | | | | The display value will be Reset Start status as soon as it reaches to 2nd setting value. <ul style="list-style-type: none"> • 1st retained output will be OFF after 2nd one-shot output. • 1st one-shot output will be reset after operating 0.5sec, and it is not related to 2nd output. |
| R ON OFF | | | | | Display value will be maintained until 2nd output is Off, then it will be reset. <ul style="list-style-type: none"> • 1st retained output will be OFF after 2nd one-shot output. • 1st one-shot output will be reset after operating 0.5sec, and it is not related to 2nd output. |
| K ON OFF | | | | | The display value continues until Reset signal applied. <ul style="list-style-type: none"> • 1st retained output will be OFF after 2nd one-shot output. • 1st one-shot output will be reset after operating 0.5sec, and it is not related to 2nd output. |
| P ON OFF | | | | | The display value will be Reset Start status as soon as it reaches to 2nd setting value. <ul style="list-style-type: none"> • 1st retained output will be OFF after 2nd one-shot output. • 1st one-shot output will be reset after operating 0.5sec, and it is not related to 2nd output. |
| Q ON OFF | | | | | The display continues until 2nd output is OFF. <ul style="list-style-type: none"> • 1st retained output will be OFF after 2nd one-shot output. • 1st one-shot output will be reset after operating 0.5sec not related to 2nd output. |
| S | Up | | Down | | <ul style="list-style-type: none"> • Up, Up/Down-A, B, C input mode <ul style="list-style-type: none"> - OUT1 is ON when (Display value) ≥ (1st setting value) - OUT2 is ON when (Display value) ≥ (Dual setting value) • Down, Up/Down-D, E, F input mode <ul style="list-style-type: none"> - OUT1 is ON when (Display value) ≤ (1st setting value) - OUT2 is ON when (Display value) ≤ (Zero) |
| Counter ON OFF | | | | | |
| | Up / Down-A, B, C | | Up / Down-D, E, F | | |
| S | | | | | When it is used as Timer, 1st output and 2nd output are flashing repeatedly. |

✕ One-shot output time is set by front TIME adjuster.

| | |
|-----|---|
| (A) | Photoelectric Sensors |
| (B) | Fiber Optic Sensors |
| (C) | Door/Area Sensors |
| (D) | Proximity Sensors |
| (E) | Pressure Sensors |
| (F) | Rotary Encoders |
| (G) | Connectors/ Connector Cables/ Sensor Distribution Boxes/Sockets |
| (H) | Temperature Controllers |
| (I) | SSRs / Power Controllers |
| (J) | Counters |
| (K) | Timers |
| (L) | Panel Meters |
| (M) | Tacho / Speed / Pulse Meters |
| (N) | Display Units |
| (O) | Sensor Controllers |
| (P) | Switching Mode Power Supplies |
| (Q) | Stepper Motors & Drivers & Controllers |
| (R) | Graphic/ Logic Panels |
| (S) | Field Network Devices |
| (T) | Software |

FX/FXH/FXL Series

■ Proper Usage


○ Reset

● Reset

In case of changing the input mode after supplying the power, please provide an external reset or manual reset. If reset is not executed, the counter will be working in previous mode.

● Reset signal width


To guarantee proper reset, the signal must be supplied for a minimum of **min. 20ms** regardless the signal comes from a contact or a solid-state input.

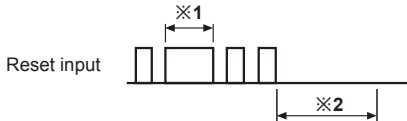

※1: In case of a contact reset, contact chattering will not affect the reset as long as it is applied for a minimum of 20ms.

※2: Input signal at CP1 & CP2 must be applied for a minimum of 50ms after the reset is removed.

○ Mini. count signal width

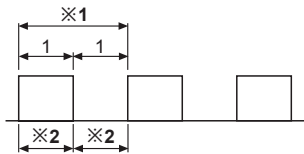


※1: Please make duty ratio (ON/OFF) as 1:1.

※2: Min. signal width

- 1cps: Min. 500ms
- 30cps: Min. 16.7ms
- 2kcps: Min. 0.25ms
- 5kcps: Min. 0.1ms

○ Max. counting speed

This is a response speed per 1 sec when the duty ratio (ON/OFF) of input signal is 1:1. If the duty ratio is not 1:1, the width between ON and OFF should be over min. signal width and the response speed will getting slower against input signal. If either ON or OFF signal is shorter than minimum signal width, this product may not respond.




T_a (ON width) and T_b (OFF width) needed to be over min.signal width.

Max. counting speed is 1/2 value of rated spec. when duty ratio is 1:3.


It can not respond if it is smaller than min. signal width (T_a).

○ Power

The inner circuit voltage starts to rise up for the first 100ms after power on, the input may not work at this time. And also the inner circuit voltage drops down for the last 500ms after power off, the input may not work at this time.




○ INHIBIT (For timer)



※1: Connection for PNP
※2: Connection for NPN

- INHIBIT mode is active when SW1 turns ON. (Time Hold)
- When power is applied, it starts to progress and INHIBIT mode is used to stop the time is under the progress at the moment.
- When SW1 is OFF, timer starts to progress again.

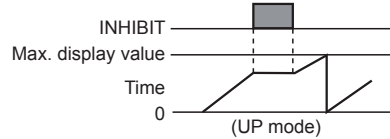


○ How to use the sticker

The below sticker can be found inside the box. Use the sticker according to application as follow;

E.g. 1) Measurement of length by the rotary encoder

E.g. 2) Timer [F mode]

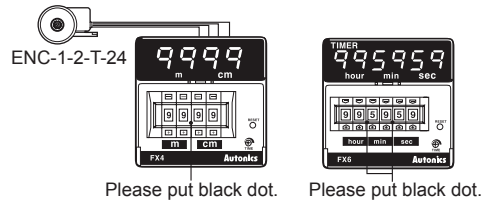

Please put black dot.

Please put black dot.

○ Error display


| Error signal | Error description | Returning method |
|--------------|--|--|
| Err-D | When 2nd setting value is 0 | Change the setting value to non zero status |
| | When 2nd setting value is smaller than 1st setting value | Make 2nd setting value bigger than 1st setting value |

※There is no Error display function in indication type.

※There is no Error function in indicator.

※When Error is display, the OUTPUT continues OFF state.


※1st output maintains OFF status by 1st setting value as 0.

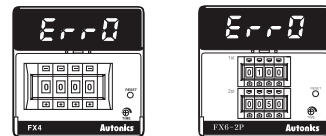

○ Case & DIP switch detachment

● FXH Series

- ① Push down the front guide.
- ② Pull out the front guide.



● FXL Series



Unscrew the rear bolt, and pull the body backward.



※Please be careful of the injury caused by tools.